SHEET NOTES

1. ALL AIR DEVICES ARE TO BE CLEANED. CONTRACTOR TO REVIEW OPERABILITY AND APPEARANCE OF DIFFUSERS. NOTIFY CLIENT AND ARCHITECT OF DAMAGED AND INOPERABLE DIFFUSERS.
2. CONTRACTOR SHALL FIELD SURVEY TO VERIFY ALL EXISTING CONDITIONS ASSOCIATED WITH SCOPE OF WORK PRIOR TO SUBMITTING BIDS. ANY ADDITIONAL WORK REQUIRED ASSOCIATED WITH FAILURE TO PERFORM A FIELD SURVEY PRIOR TO SUBMITTING BIDS SHALL BEAT TO ADDITIONAL COST TO OWNER.
3. CONTRACTOR SHALL VERIFY THERMOSTATS SERVE INDICATED ZONES.
4. CONTRACTOR SHALL VERIFY EXISTING AIR DEVICES HAVE FIRE RATED ACCESSORIES. PROVIDE NEW AS REQUIRED.
5. PROVIDE PREBALANCE REPORT ON EXISTING DIFFUSERS AND VAV BOXES AFFECTED BY THIS RENOVATION PRIOR TO ANY DEMOLITION WORK. NOTIFY OWNER AND ENGINEER OF ALL DEFICIENCIES FOUND IN ANY OF THE SYSTEMS.

NUMBERED NOTES

KEYED NOTE	DESCRIPTION
1	REBALANCE EXISTING SLOT DIFFUSER TO CFM INDICATED.
2	RELOCATE EXISTING DIFFUSER TO LOCATION SHOWN. REPLACE FLEX DUCT AS NECESSARY. REBALANCE DIFFUSER TO CFM INDICATED. CONTRACTOR TO CLEAN DIFFUSER AND REVIEW OPERABILITY AND APPEARANCE. NOTIFY CLIENT AND ARCHITECT OF DAMAGED AND INOPERABLE GRILLES.
3	REBALANCE EXISTING SUPPLY DIFFUSER TO CFM INDICATED.
4	RELOCATE EXISTING DIFFUSER AS SHOWN. REMOVE ASSOCIATED DUCTWORK BACK TO MAIN. CAP AND SEAL MAIN AIR TIGHT. REBALANCE DIFFUSER TO CFM INDICATED. CONTRACTOR TO CLEAN DIFFUSER AND REVIEW OPERABILITY AND APPEARANCE. NOTIFY CLIENT AND ARCHITECT OF DAMAGED AND INOPERABLE GRILLES.
5	DEMO EXISTING DIFFUSER, FLEX AND SPIRAL DUCT BACK TO MAIN. CAP AND SEAL MAIN AIR TIGHT. RETURN DIFFUSER TO BUILDING OWNER'S REPRESENTATIVE.
6	EXISTING THERMOSTAT TO REMAIN. CONTRACTOR TO FIELD VERIFY EXACT LOCATION.
7	RELOCATE EXISTING THERMOSTAT IN APPROXIMATE LOCATION AND TIE INTO DESIGNATED EQUIPMENT CONTROLS. COORDINATE EXACT FINAL LOCATION WITH ARCHITECT.
8	PROVIDE NEW BUILDING STANDARD THERMOSTAT IN APPROXIMATE LOCATION AND TIE INTO DESIGNATED EQUIPMENT CONTROLS AS REQUIRED. COORDINATE EXACT FINAL LOCATION WITH ARCHITECT.
9	RELOCATE EXISTING RETURN AIR GRILLE AS INDICATED. CONTRACTOR TO CLEAN DIFFUSER AND REVIEW OPERABILITY AND APPEARANCE. NOTIFY CLIENT TO AND ARCHITECT OF DAMAGED AND INOPERABLE DIFFUSERS.

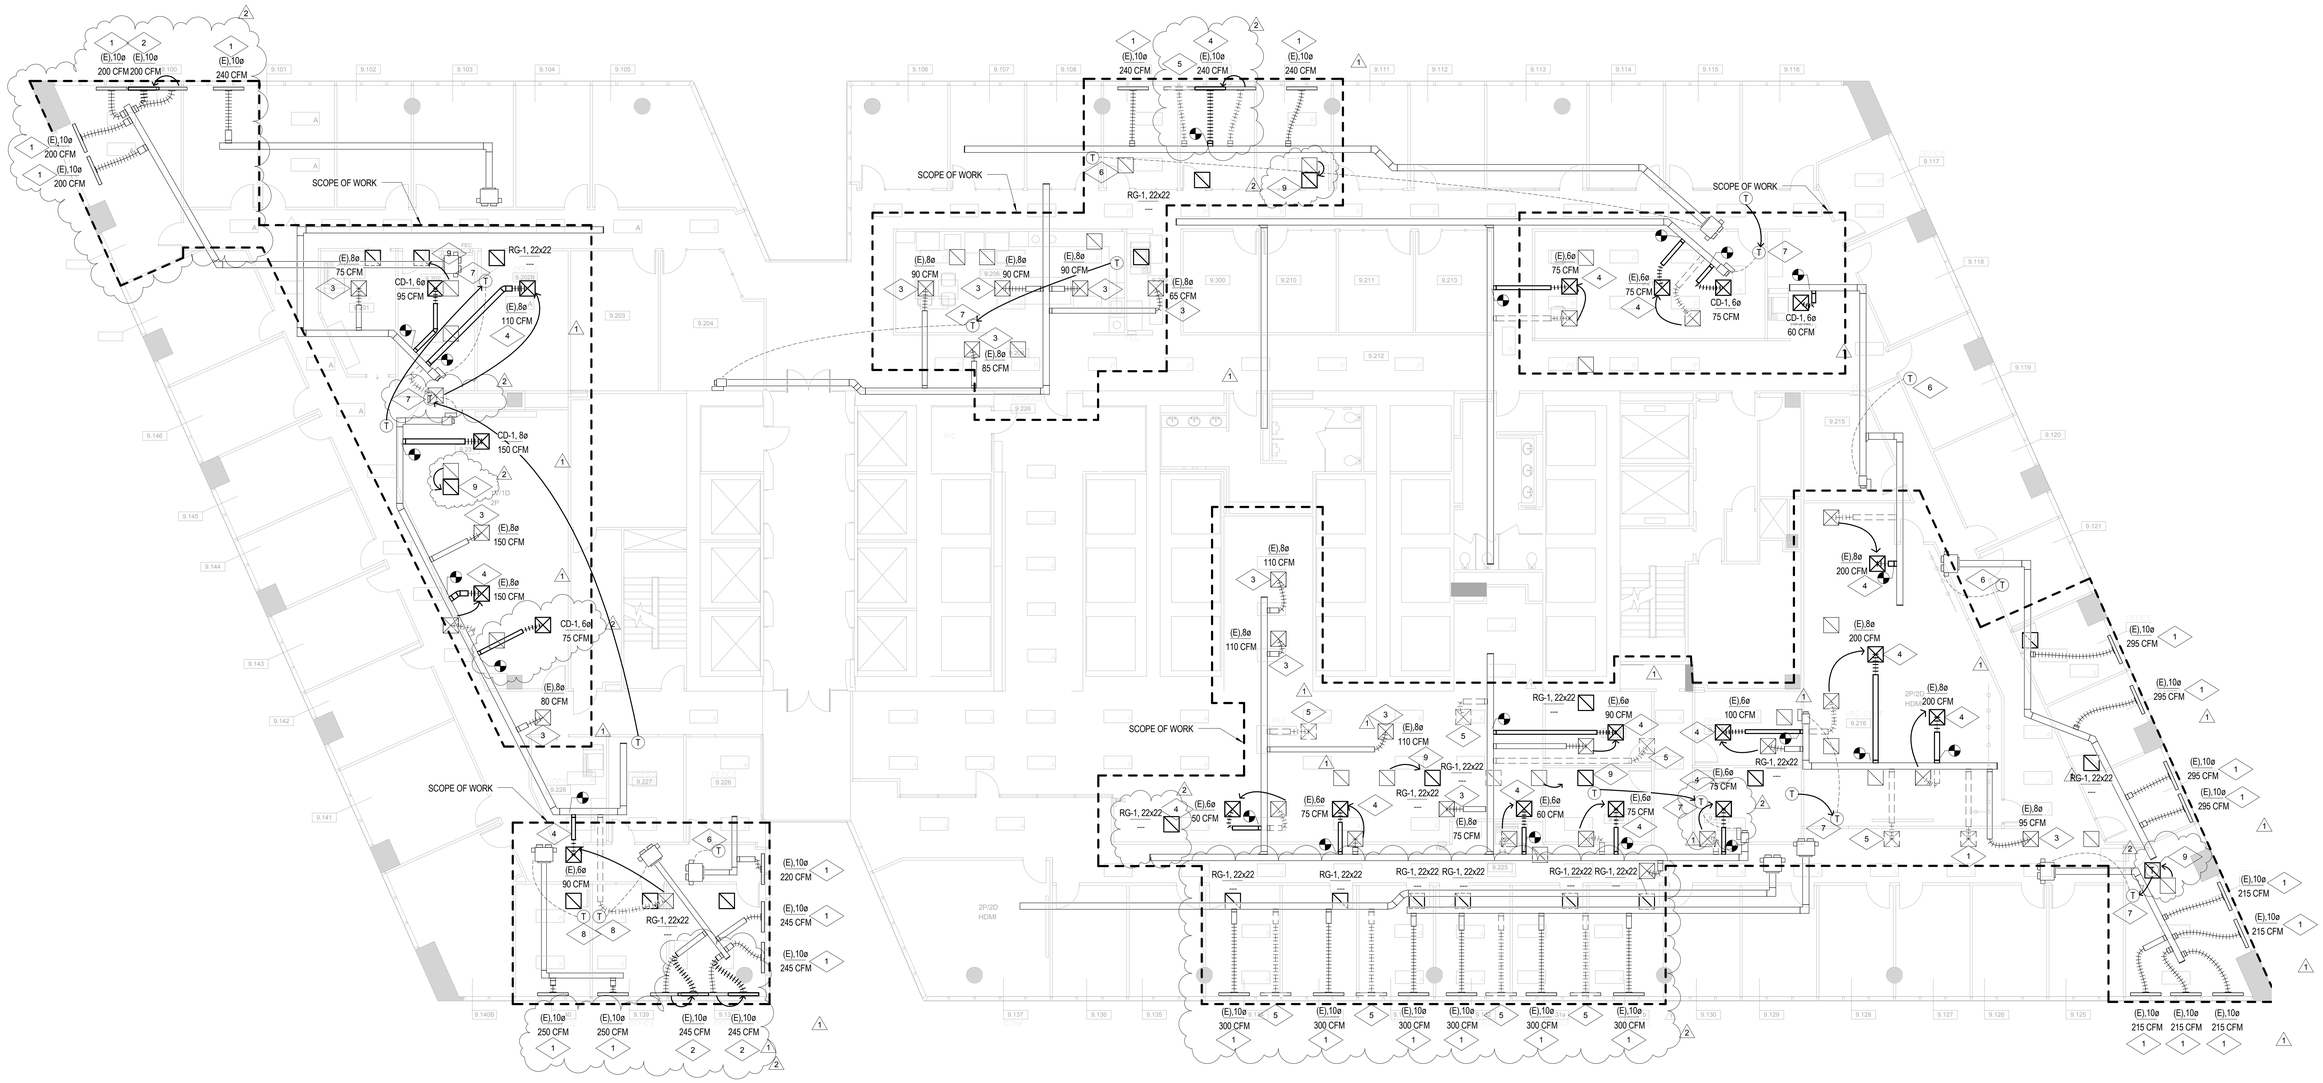

1 MECHANICAL FLOOR PLAN
SCALE: 1/8" = 1'-0"

ZIEGLER COOPER

700 Louisiana Street, Suite 350
Houston, Texas 77002
713.374.0000
www.zieglercooper.com

WSP

TBPE Registration Number: F-14907
808 Travis Street, Suite 200
Houston, TX 77002
(713)-237-8900
www.wspgroup.com/usa

ISSUES AND REVISIONS

NO.	DATE	DESCRIPTION
	09.14.16	ISSUED FOR PRICING AND CONSTRUCTION
1	09.29.16	BUILDING COMMENTS
2	05.02.17	REVISION 01

PROJECT MANAGER:	JM
DRAWN BY:	KD
CHECKED BY:	DG

STATE OF TEXAS
JONATHAN D. MILLER
110124
LICENSED
PROFESSIONAL ENGINEER
05/02/2017

Enervest

1001 FANNIN
LEVEL 9 SUITE 900
HOUSTON, TEXAS 77002

SHEET TITLE

MECHANICAL FLOOR PLAN

SHEET NUMBER

M02.09

ZCA PROJECT # Project Number

N

© 2014 Ziegler Cooper Architects
Architect shall own the overall conceptual design prepared and developed for the project and the intangible exclusive rights or copyright therein.